




Do not scale off this drawing
All dimensions should be checked on site
E. & O.E.

© ACCESS IRRIGATION LTD

NOZZLE CODE	NOZZLE OUTPUT	BED WIDTH WIDTH	SPACING BETWEEN SPRINKLERS
KES040	40 L/h	2.2m	2.0m
KES070	70 L/h	3.0m	2.5m

Note: most domestic gardens have a water supply of between 600 L/h and 800 L/h

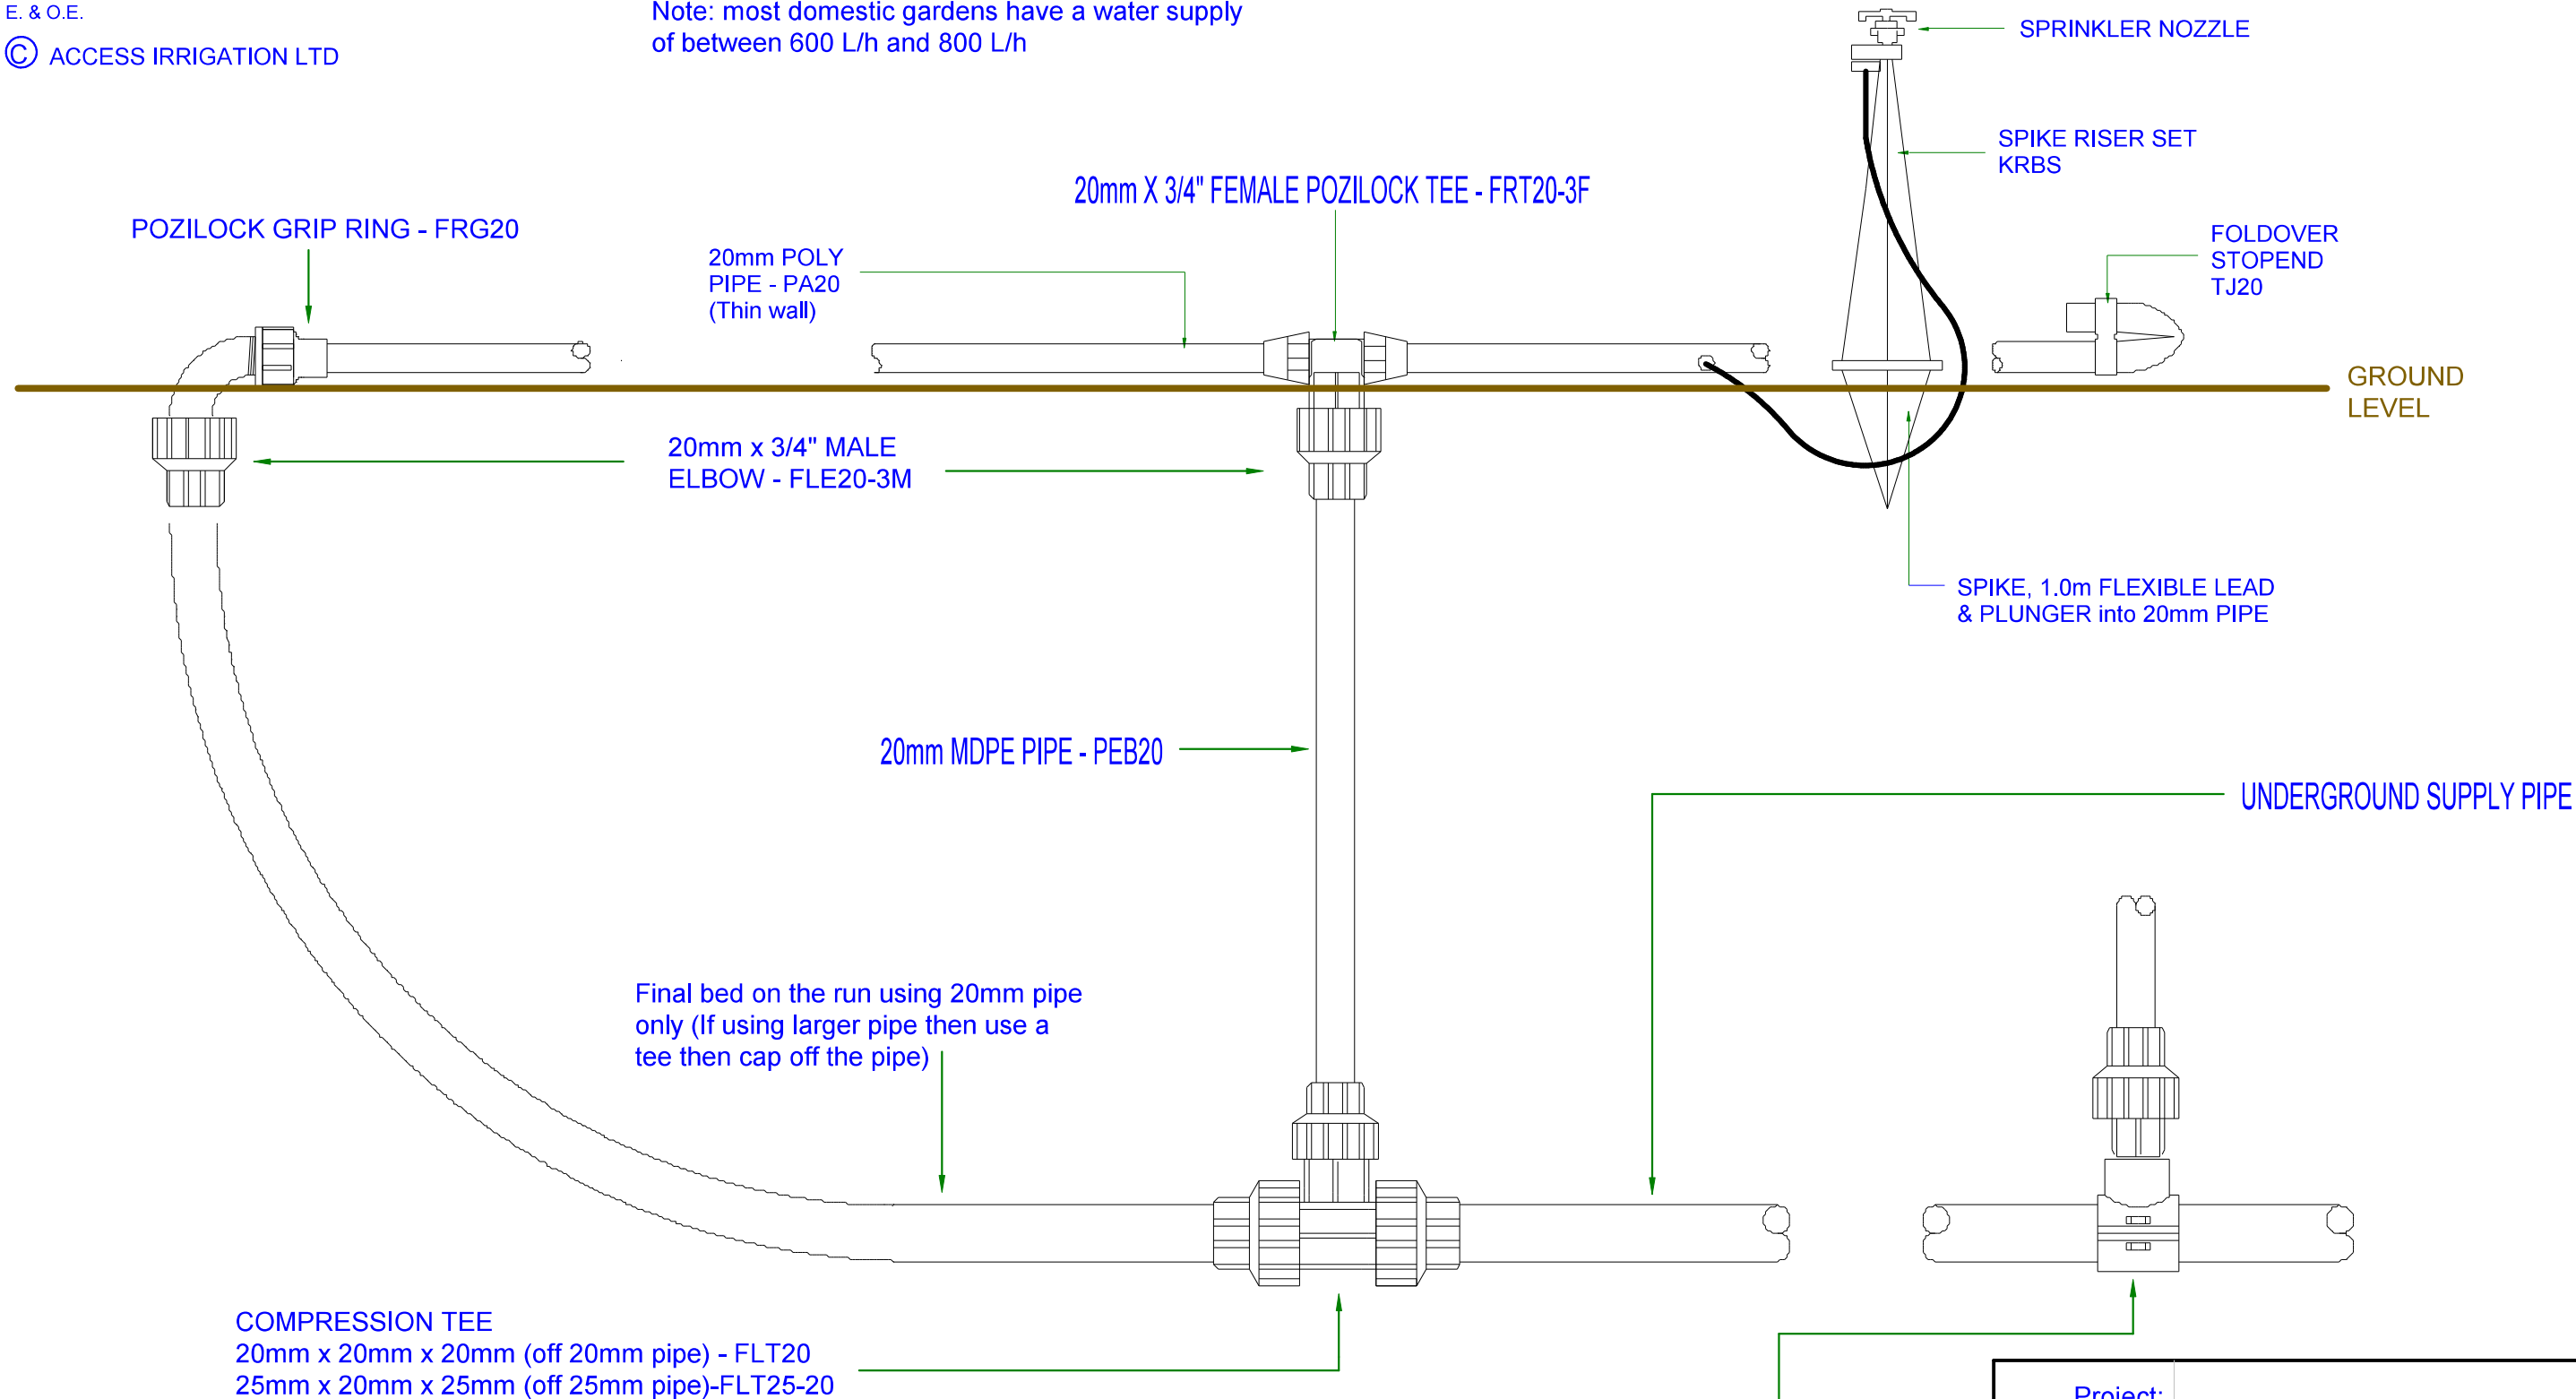

NOTE - If you are starting in the middle of the border use FRT20-3F pozi-lock female tee. If you are start the dripline at the end of the border then use the pozi-lock grip ring directly onto FLE20-3M elbow.