




Do not scale off this drawing
All dimensions should be checked on site
E. & O.E.

© ACCESS IRRIGATION LTD

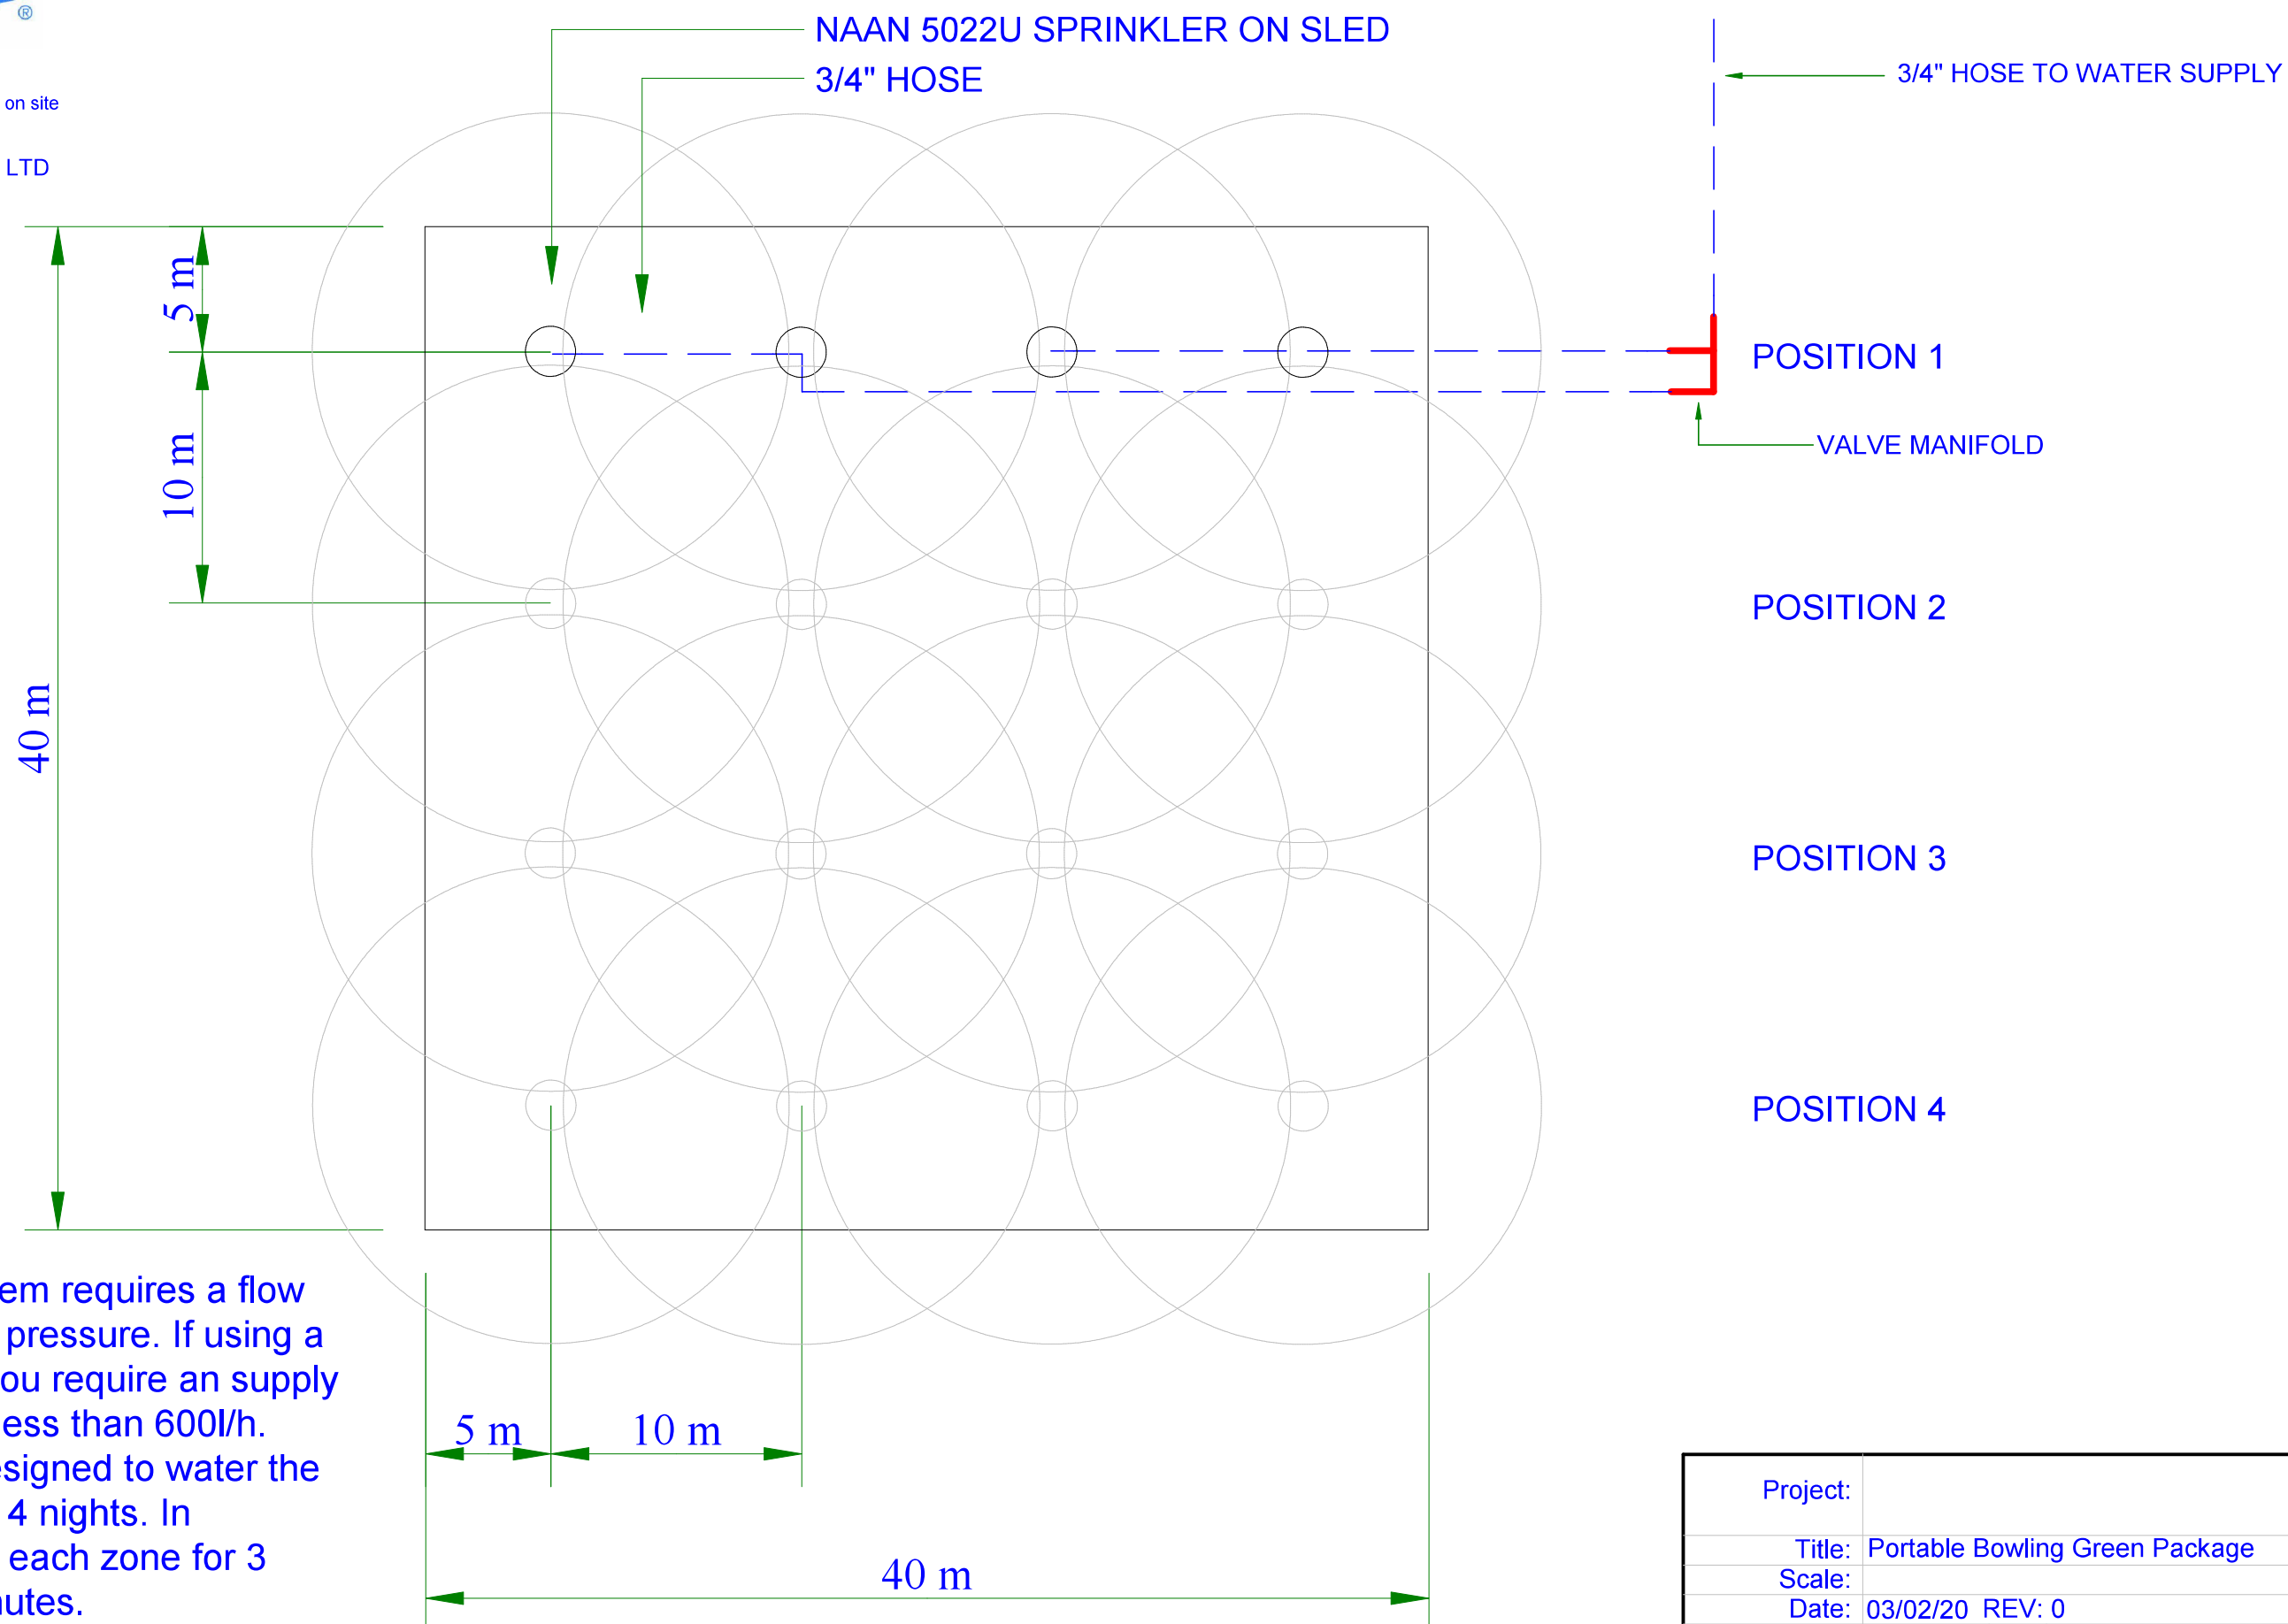

NOTE - This system requires a flow of 720l/h at 3 bar pressure. If using a 1250l tank then you require an supply to the tank of no less than 600l/h. This system is designed to water the entire green over 4 nights. In summer, operate each zone for 3 hours and 20 minutes.

Project:	
Title:	Portable Bowling Green Package
Scale:	
Date:	03/02/20 REV: 0
Drawing No:	SB1GTP4